भारतीय मानक Indian Standard

IS 1199 (Part 7): 2018

ताजा कंक्रीट — नमूने लेना, परीक्षण एवं विश्लेषण पद्धतियाँ

भाग 7 प्रवेश प्रतिरोधन द्वारा कंक्रीट के जमने के समय का निर्धारण

(पहला पुनरीक्षण)

Fresh Concrete — Methods of Sampling, Testing and Analysis

Part 7 Determination of Setting Time of Concrete by Penetration Resistance

(First Revision)

ICS 91.100.30

© BIS 2018



भारतीय मानक ब्यूरो BUREAU OF INDIAN STANDARDS

मानक भवन, 9 बहादुरशाह ज़फर मार्ग, नई दिल्ली-110002 प्रथमदर्शकः MANAK BHAVAN, 9 BAHADUR SHAH ZAFAR MARG NEW DELHI-110002

www.bis.org.in www.standardsbis.in

FOREWORD

This Indian Standard (Part 7) (First Revision) was adopted by the Bureau of Indian Standards, after the draft finalized by the Cement and Concrete Sectional Committee had been approved by the Civil Engineering Division Council.

Testing plays an important role in controlling the quality of cement concrete work. Systematic testing of the raw materials, the fresh concrete and the hardened concrete, is an inseparable part of any quality control programme for concrete. This helps achieve a higher efficiency of the materials used and greater assurance of the performance of the concrete, in regard to workability, strength and durability. The test methods used should be simple, direct and convenient to apply. This standard was formulated with this objective in view.

This standard was first published in 1959. In this revision, it was decided to review and update the various existing test methods of fresh concrete taking into consideration the latest international practices and developments in this field in the country, and also introduced certain new test methods, wherever required. In the process, the various existing test methods covered in IS 1199:1959 'Methods of sampling and analysis of concrete' have been revised. The revision of standard is being brought out taking into consideration primarily the corresponding ISO Standards while also examining the other best practices world over and in the country. In addition, test methods for determination of properties of new types of concrete like self compacting concrete have been included, covering tests such as consistency, viscosity, passing ability and segregation resistance. Also, for better understanding and implementation, some of the other test methods which were spread over in other Indian Standards have been brought together under the fold of IS 1199 as its various parts, such as the setting time of concrete by penetration method and, water soluble and acid soluble chlorides in mortar and concrete. This is with a view to making the standard complete in all respects, and rendering it a comprehensive source of provisions for testing of concrete and reference in other Indian Standards.

In this revision, IS 1199 has been split into nine parts. The other parts in the series are:

- Part 1 Sampling of fresh concrete
- Part 2 Determination of consistency of fresh concrete
- Part 3 Determination of density of fresh concrete
- Part 4 Determination of air content of fresh concrete
- Part 5 Making and curing of test specimens
- Part 6 Tests on fresh self compacting concrete
- Part 8 Determination of water soluble and acid soluble chlorides in mortar and concrete
- Part 9 Analysis of freshly mixed concrete

This standard (Part 7) covers the determination of the setting time of concrete with slump greater than zero, by testing mortar sieved from the concrete mixture.

This test method shall be applicable as and when published in place of the corresponding IS 8142: 1976 'Method of test for determining setting time of concrete by penetration resistance', which shall be superseded after the publication of this standard.

This revision of the standard has been taken up to incorporate the modifications found necessary in the light of experience gained in its use and also to bring it in line with the latest development on the subject. A significant provision in this revision is that the graph of time taken *versus* penetration resistance has been introduced for interpolation of initial setting time and final setting time of concrete, corresponding to a penetration resistance of 3.5 and 27.6 MPa, respectively.

The composition of the Committee responsible for the formulation of this standard is given in Annex A.

In reporting the result of a test or analysis made in accordance with this standard, if the final value, observed or calculated, is to be rounded off, it shall be done in accordance with IS 2: 1960 'Rules for rounding off numerical-values (*revised*)'.

Indian Standard

FRESH CONCRETE — METHODS OF SAMPLING, TESTING AND ANALYSIS

PART 7 DETERMINATION OF SETTING TIME OF CONCRETE BY PENETRATION RESISTANCE

(First Revision)

1 SCOPE

- 1.1 This standard (Part 7) covers the method for determining the setting time of concrete with slump greater than zero, by testing mortar sieved from the concrete mixture. The initial setting time and the final setting time are the time intervals required for the mortar sieved from the concrete mixture to reach the specified values of penetration resistance measured from the initial contact of cement and water.
- 1.2 The method may be used for determining the effect of variables such as temperature, type and content of cement, concrete mix proportions and admixtures, upon the time of setting and hardening characteristics of concrete.
- **1.3** This test method is applicable under controlled laboratory conditions, as well as under field conditions.

2 TERMINOLOGY

For the purpose of this standard, the following definitions shall apply.

- **2.1 Initial Setting Time** The time elapsed after initial contact of cement and water, till the mortar (sieved from the concrete) acquires a penetration resistance of 3.5MPa.
- **2.2 Final Setting Time** The time elapsed after the initial contact of cement and water, till the mortar (sieved from the concrete) acquires a penetration resistance of 27.6 MPa.

3 PRINCIPLE

The mortar sample is obtained by sieving a representative sample of fresh concrete. The mortar sample is placed in a container and stored at a specified ambient temperature. At regular time intervals, the resistance of the mortar to penetration by standard needles is measured. From a plot of penetration resistance *versus* elapsed time, the time of initial and final setting are determined.

4 APPARATUS

4.1 Containers for Mortar Specimens, shall be rigid, watertight, non-absorptive, free of oil/grease, either

cylindrical or rectangular in cross-section, with minimum lateral dimension 150 mm and height at least 150 mm. The container for the mortar from the concrete mixture shall provide enough mortar surfaces for ten undisturbed readings of penetration resistance in accordance with clear distance requirements specified in **8.2**.

4.2 Penetration Resistance Apparatus, spring reaction-type apparatus, graduated from 50 N to 600 N in increments of 10 N or less; or hydraulic reaction-type apparatus with pressure gauge of 700 to 900 N capacity, graduated in increments of 10 N or less.

Indications of actual needle loads by these apparatus shall be accurate to 10 N. Removable needles of 645, 323, 161, 65, 32, and 16 mm² bearing areas shall be provided. Each needle shank shall be scribed peripherally at a distance of 25 mm above the bearing face. The length of the 16 mm² needle shall be not more than 90 mm to minimize bending. The apparatus shall be recalibrated periodically.

- **4.3 Pipette,** or other suitable instrument for drawing off free water from the surface of the test specimens shall be used.
- **4.4 Tamping Rod**, of circular cross-section, straight, made of steel, having a diameter of 16 ± 1 mm, a length of 600 ± 5 mm and having rounded ends.
- **4.5 Thermometer,** capable of measuring the temperature of the fresh mortar to an accuracy of 0.5°C. Glass thermometers having a temperature range from 0°C to 100°C or other thermometers of the required accuracy, including the metal immersion type, are acceptable.

5 PREPARATION OF MORTAR SPECIMENS

5.1 From the concrete mixture under test, select a representative sample of concrete of sufficient volume to provide enough mortar to fill the test container, or containers, to a depth of at least 140 mm.

Remove all the mortar from the sample of concrete by sieving it through a 4.75mm IS sieve onto a non-absorptive surface.

5.2 Thoroughly mix the mortar manually on the non-absorptive surface. Measure and record the temperature of the mortar. Place the mortar in the container, or containers, in a single layer. Compact the mortar to eliminate air pockets in the specimen and level the top surface. This may be accomplished by rocking the container back and forth on a solid surface, or by tapping the sides of the container. Sieved mortar is generally of fluid consistency and air pockets are readily removed by this method of compaction.

For stiffer mortars, alternative method as given below, by tamping with the tamping rod, shall be followed.

Place the mortar in the container(s) in layers of 50 mm each, and compact by tamping each layer. Tamp the mortar once for each 6.5 cm² of top surface area of the specimen and distribute the strokes uniformly over the cross-section of the specimen. After completion of the tamping, tap the sides of the containers lightly with the tamping rod to remove voids left by the tamping rod and to further level the surface of the specimen.

Upon completion of specimen preparation, the mortar surface shall be at least 13 mm below the top edge of the container to provide space for the collection and removal of bleeding water and to avoid contact between the mortar surface and the protective covering specified in 8.

6 STORAGE OF MORTAR SPECIMENS

- **6.1** For test under laboratory conditions, store the specimens, at a temperature of $27 \pm 2^{\circ}$ C.
- **6.2** For tests under field conditions, store the specimens under ambient conditions, or as specified by the user. Shield the specimens from direct sunlight.
- **6.3** Measure and record the ambient air temperature at the start and finish of the test. To prevent excessive evaporation of moisture keep the specimens covered with a suitable material such as a damp burlap or a tight fitting, water impermeable cover, for the duration of the test, except when the bleed water is being removed or penetration tests are being made.

7 NUMBER OF SPECIMENS

- **7.1** For tests under field conditions, prepare three specimens from each sample of concrete.
- **7.2** For tests under laboratory conditions, the requirements depend upon the purpose of the tests.
- **7.2.1** For testing to prove compliance of a material with performance requirements, at least three separate batches shall be made for each test condition. One test shall be made on each batch. An equal number of batches for each condition shall be made on any given day. When it is impossible to make at least one test for each variable

on a given day, the mixing of the entire series of batches shall be completed in as few days as possible and one of the mixtures shall be repeated each day as a standard of comparison.

7.2.2 For other tests, prepare three test specimens from one batch of concrete for each test variable.

8 PROCEDURE

- **8.1** Remove bleed water from the surface of the mortar specimens just prior to making a penetration test by means of a pipette or a suitable instrument. To facilitate the collection of bleeding water, tilt the specimen carefully to an angle of about 10° from the horizontal by placing a block under one side 2 min prior to removal of the water.
- **8.2** Insert a needle of appropriate size, depending upon the state of hardening of the mortar, in the penetration resistance apparatus and bring the bearing surface of the needle into contact with the mortar surface. Gradually and uniformly apply a vertical force downward on the apparatus until the needle penetrates the mortar to a depth of 25 mm as indicated by the scribe mark. The time required to penetrate to the 25 mm depth shall be approximately 10 s. Record the force required and the time of application, measured as elapsed time after initial contact of cement and water. In subsequent penetration tests take care to avoid areas where the mortar has been disturbed by previous tests. The clear distance between two needle impressions shall be at least two diameters of the needle being used, but not less than 13 mm. The clear distance between any needle impression and the side of the container shall be not less than 25 mm.
- **8.3** Make penetration tests at hourly intervals for normal mixtures and normal temperatures, the initial test being made after an elapsed time of 2 to 3 h. For accelerated mixtures or high temperatures, it may be advisable to make the initial test after an elapsed time of 1 or 2 h and subsequent tests at 30 min intervals. For low temperature conditions or retarded concrete mixtures, the initial penetration test may be deferred for an elapsed time of 4 to 6 h and perhaps longer. Subsequent tests may be made at intervals of 1 h, unless the rate of increase in penetration resistance indicates that shorter intervals are desirable.
- **8.4** Not less than six penetrations shall be made in each rate of hardening test and the time intervals between penetration resistance determinations shall be such as to give a satisfactory rate of hardening curve, as indicated by equally spaced points. Continue the tests until a penetration resistance of at least 27.5 MPa is reached

Calculate the penetration resistance in MPa, as the force

required to cause a 25 mm depth of penetration of the needle divided by the area of the bearing face of the needle.

NOTE — When carrying out this test, prevent skin contact with fresh concrete by wearing suitable protective clothing, gloves and footwear. If wet cement or concrete enters the eye, immediately wash it out thoroughly with clean water and seek medical treatment without delay. Wash fresh concrete off the skin immediately.

9 PLOTTING TEST RESULTS AND CALCULATION

9.1 Curves

For each variable and condition of concrete as specified

in 7 the results from each of three or more rate of hardening tests shall be plotted separately, showing penetration resistance in MPa as the ordinate or y-axis and elapsed time in hours and minutes as the abscissa or x-axis, where 3.5 MPa and 1h are represented by not less than 15 mm.

A typical curve plotting penetration resistance (MPa) *versus* elapsed time (min) based on test observations is shown in Fig. 1.

9.2 Time of Setting

Times of initial and final setting as defined in 2.1 and 2.2 shall be calculated by averaging the elapsed

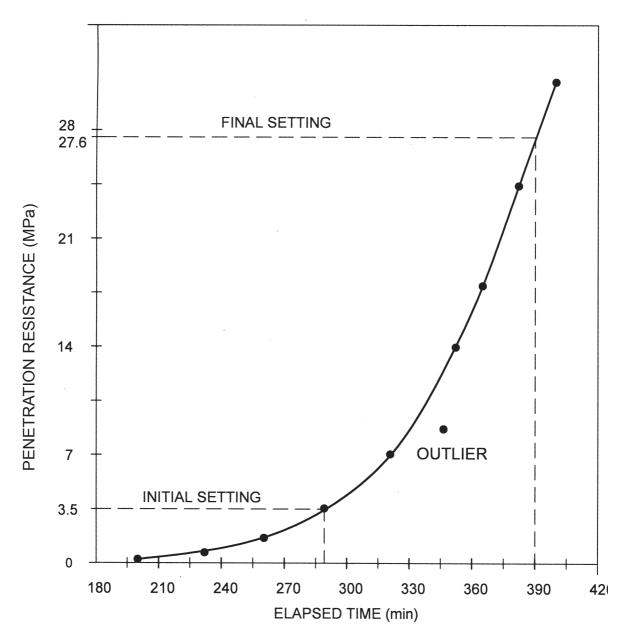


Fig. 1 Plot of Penetration Values *versus* Elapsed Time and Hand Fit Curve Used to Determine Time of Setting

times, determined from the curves plotted in accordance with 9.1. Times of setting shall be reported in hours and minutes to the nearest minutes.

10 REPORT

The report shall include the following:

- a) Identification of the test sample;
- b) Location, where the test was performed;
- c) Date and time of test;
- d) Temperature at which test was conducted laboratory/ambient/as specified (mention the value of the temperature in case of ambient/ as specified condition of testing);

- e) Data on concrete mix (Grade, mix proportions, and maximum nominal size of aggregates);
- f) Consistency of concrete as determined by the slump or other test for consistency;
- g) The initial and final setting time as observed, in hours and minutes, to the nearest minute;
- h) Any deviation from the standard test method;
- j) Declaration by the person technically responsible for the test that it was carried out in accordance with this standard, except as noted in (h); and
- k) The report may also include temperature of the mortar after sieving.

ANNEX A

(Foreword)

COMMITTEE COMPOSITION

Cement and Concrete Sectional Committee, CED 02

8
In Personal Capacity (14A, Summer Breeze, Kuravankonam, Kowdiar, Thiruvananthapuram 695 003)
ACC Ltd, Mumbai
,
Ambuja Cements Limited, Ahmedabad

Organization

Builders' Association of India, Mumbai

Building Materials and Technology Promotion Council, New Delhi

Cement Manufacturers' Association, Noida

Atomic Energy Regulatory Board, Mumbai

Central Public Works Department, New Delhi

CSIR - Central Building Research Institute, Roorkee

CSIR - Central Road Research Institute, New Delhi

CSIR - Structural Engineering Research Centre, Chennai

Central Soil and Materials Research Station, New Delhi

Central Water Commission, New Delhi

Conmat Technolgies Pvt Ltd, Kolkata

Construction Chemical Manufacturers' Association, Mumbai

Delhi Development Authority, New Delhi

Department of Science and Technology, Ministry of Science and Technology, New Delhi

Engineers India Limited, New Delhi

Gammon India Limited, Mumbai

Hindustan Construction Company Limited, Mumbai

Housing and Urban Development Corporation Limited, New Delhi Indian Association of Structural Engineers, New Delhi

Indian Concrete Institute, Chennai

Indian Institute of Technology Delhi, New Delhi Indian Institute of Technology Madras, Chennai Representative(s)

Shri Jose Kurian (Chairman)

SHRI S. A. KHADILKAR
SHRI RAMAN SADANAND PARULEKAR (Alternate)

Shri J. P. Desai Dr Bibekananda Mohapatra (*Alternate*)

SHRI L. R. BISHNOI SHRI SOURAV ACHARYA (Alternate)

SHRI SUSHANTA KUMAR BASU
SHRI D. R. SEKOR (Alternate)

SHRI J. K. PRASAD SHRI C. N. JHA (*Alternate*)

Shri Rakesh Bhargava Dr S. K. Handoo (*Alternate*)

Shri A. K. Garg Shri Rajesh Khare (*Alternate*)

SHRI S. K. SINGH
SHRI SUBHASH GURRAM (Alternate)

SHRI J. B. SENGUPTA
SHRI SATISH PANDEY (Alternate)

Dr K. Ramanjaneyulu Dr P. Srinivasan (*Alternate*)

SHRI N. SIVA KUMAR (Alternate)

DIRECTOR (CMDD) (N&W)
DEPUTY DIRECTOR (CMDD) (NW&S) (Alternate)

Dr A. K. Chatterjee Shri Subrato Chowdhury (*Alternate*)

SHRI SAMIR SURLAKER
SHRI NILOTPOL KAR (Alternate)

SHRI LAXMAN SINGH
SHRI VIJAY SHANKAR (Alternate)

Shri Chander Mohan

SHRI RAJANJI SRIVASTAVA
SHRI ANURAG SINHA (Alternate)

SHRI V. N. HEGGADE SHRI S. C. UPADHYAY (Alternate)

SHRI SATISH KUMAR SHARMA
DR CHETAN HAZAREE (Alternate)

SHRI DEEPAK BANSAL
SHRI MAHESH TANDON

Shri Ganesh Juneja (Alternate)

Shri Vivek Naik Secretary General (*Alternate*)

REPRESENTATIVE
PROF DEVDAS MENON

DR MANU SANTHANAM (Alternate)

Organization

Indian Institute of Technology Roorkee, Roorkee

Indian Roads Congress, New Delhi

Institute for Solid Waste Research and Ecological Balance, Visakhapatnam

Nuvoco Vistas Corporation Limited, Mumbai

Military Engineer Services, Engineer-in-Chief's Branch, Army HQ, New Delhi

Ministry of Road Transport and Highways, New Delhi

National Council for Cement and Building Materials, Ballabgarh

National Test House, Kolkata

Nuclear Power Corporation of India Ltd, Mumbai

OCL India Limited, New Delhi

Public Works Department, Govt of Tamil Nadu, Chennai

The India Cements Limited, Chennai

The Indian Hume Pipe Company Limited, Mumbai

The Institution of Engineers (India), Kolkata

The Ramco Cements Limited, Chennai

Ultra Tech Cement Ltd, Mumbai

Voluntary Organization in Interest of Consumer Education, New Delhi

In personal capacity [B-806, Oberoi Exquisite, Oberoi Garden City, Goregaon (East), Mumbai]

In personal capacity (36, Old Sneh Nagar, Wardha Road, Nagpur)

In personal capacity (EA-92, Maya Enclave, Hari Nagar, New Delhi)

In personal capacity (E-1, 402, White House Apartments, R. T. Nagar, Bengaluru)

BIS Directorate General

Representative(s)

PROF V. K. GUPTA

DR BHUPINDER SINGH (Alternate)

SECRETARY GENERAL
DIRECTOR (Alternate)

 $Dr\ N.\ Bhanumathidas$

SHRI N. KALIDAS (Alternate)

Shri Pranav Desai

Shri Ravindra Khamparia (Alternate)

Maj Gen S. K. Srivastav Shri Man Singh (*Alternate*)

Shri A. P. Pathak

SHRI A. K. PANDEY (Alternate)

Shri V. V. Arora

DR S. HARSH (Alternate)

SHRI SHIR SINGH

Shrimati S. A. Kaushil (Alternate)

SHRI ARVIND SHRIVASTAVA

Shri Raghupati Roy (Alternate)

Dr S. C. Ahluwalia

Superintending Engineer

EXECUTIVE ENGINEER (Alternate)

Dr D. Venkateswaran

SHRI P. R. BHAT

Shri S. J. Shah (Alternate)

DR H. C. VISVESVARAYA

Shri S. H. Jain (Alternate)

Shri Balaji K. Moorthy

Shri Anil Kumar Pillai (*Alternate*) Shri Surya Valluri

DR M. R. KALGAL (Alternate)

Shri M. A. U. Khan

SHRI B. MUKHOPADHYAY (Alternate)

Shri A. K. Jain

Shri L. K. Jain

SHRI R. C. WASON

Shri S. A. Reddi

Shri Sanjay Pant, Scientist 'F' and Head (Civil Engg) [Representing Director General (*Ex-officio*)]

Member Secretary
Shrimati Divya S.
Scientist 'B' (Civil Engg), BIS

Concrete Sub-committee, CED 2:2

Organization

Representative(s)

In Personal Capacity, (14A, Summer Breeze, Kuravankonam, Kowdiar, Thiruvananthapuram 695 003)

ACC Limited, Mumbai

Ambuja Cement Limited, Ahmedabad

Association of Consulting Civil Engineers (India), Bengaluru

Shri Jose Kurian (*Convener*)

Shri Avijit Chaubey (Alternate)

Shri J. P. Desai

Dr Bibekananda Mohapatra (Alternate)

Shri Avinash D. Shirode

Shri K. K. Meghashyam (Alternate)

Orga	

Atomic Energy Regulatory Board, Mumbai

Building Materials and Technology Promotion Council, New Delhi

Bureau of Design for Hydel and Irrigation Project, Bhopal

Central Public Works Department, New Delhi

Civil-Aid Technoclinic Pvt Ltd, Bengaluru

Creative Design Consultants and Engineers Pvt Ltd, Ghaizabad CSIR – Central Building Research Institute, Roorkee

CSIR - Central Road Research Institute, New Delhi

CSIR - Central Soil & Materials Research Station, New Delhi

CSIR-Structural Engineering Research Centre, Chennai

Department of Science and Technology, Ministry of Science and Technology, New Delhi

Elkem South Asia Pvt Ltd, Navi Mumbai

Engineers India Limited, New Delhi

Gammon India Limited, Mumbai

Hindustan Constrution Company Ltd, Mumbai

Indian Concrete Institute, Chennai

Indian Institute of Structural Engineering, Mumbai

Indian Institute of Technology Delhi, New Delhi

Indian Institute of Technology Kanpur, Kanpur Indian Institute of Technology Madras, Chennai Indian Institute of Technology Roorkee, Roorkee Indian Society of Structural Engineers, Mumbai

Irrigation and Power Research Institute, Amritsar

Larsen and Toubro Limited, ECC Division, Chennai

Military Engineer Services, Engineer-in-Chief's Branch, Army HQ, New Delhi

Ministry of Road Transport & Highways, New Delhi

National Buildings Construction Corporation Limited, Haryana

National Council for Cement & Building Materials, Ballabgarh

National Institute of Technology, Warangal

Representative(s)

SHRI L. R. BISHNOI SHRI SOURAV ACHARYA (*Alternate*)

SHRI J. K. PRASAD
SHRI PANKAJ GUPTA (Alternate)

SHRI S. K. KHARE
SHRI BHAGWATI PRASAD GUPTA (Alternate)

Shri A. K. Garg Shri Rajesh Khare (*Alternate*)

Shri M. S. Sudarshan Shri R. Nagendra (*Alternate*)

SHRI AMAN DEEP

Dr Rajesh Deolia Shri H. C. Arora (*Alternate*)

SHRI J. B. SENGUPTA
SHRI SATISH PANDEY (Alternate)

Shri Rajeev Kumar Shri M. Raja (*Alternate*)

Dr B. H. Bharath Kumar Dr P. Srinivasan (*Alternate*)

SHRI CHANDER MOHAN

Shri Brajesh Malviya Shri Surendra Sharma (*Alternate*)

SHRI RAJANJI SRIVASTAVA
SHRI ANURAG SINHA (Alternate)

Shri Manish Mokal Shri Sudeesh Rajendran (*Alternate*)

Dr Chetan Hazare Shri Avinash Harde (*Alternate*)

SHRI K. C. TAYADE
SECRETARY GENERAL (Alternate)

SHRI D. S. JOSHI
SHRI HEMANT VADALKAR (Alternate)

Dr B. Bhattacharjee Dr Shashank Bishnoi (*Alternate*)

DR SUDHIR MISHRA

Dr Manu Santhanam

Dr Ashok Kumar Jain

Shri D. S. Joshi Shri Hemant Vadalkar (*Alternate*)

CHIEF ENGINEER (RESEARCH)
RESEARCH OFFICER (Alternate)

Dr B. Sivaram Sarma Shri S. Manohar (*Alternate*)

Shri S. K. Srivastav Shri Man Singh (*Alternate*)

SHRI A. P. PATHAK
SHRI A. K. PANDEY (Alternate)

SHRI H. S. YADAV SHRI PAWAN KUMAR (Alternate)

SHRI V. V. ARORA SHRI S. SHARMA (*Alternate*)

Dr C. B. Kameswara Rao Dr D Rama Seshu (*Alternate*)

Organization

Nuclear Power Corporation of India Limited, Mumbai

Pidilite Industries Limited, Mumbai

Ready Mixed Concrete Manufacturers' Association, Mumbai

Research, Design & Standards Organization (Ministry of Railways), Lucknow

Shapoorji Pallonji and Company Private Limited, Mumbai

Tandon Consultants Pvt Limited, New Delhi

Tata Consulting Engineers Limited, Mumbai

Ultra Tech Cement Ltd, Mumbai

Water Resource Department, Govt of Madhya Pradesh, Mumbai

In personal capacity (452 Sector 14, Sonipat, Haryana)

In personal capacity (36, Old Sneh Nagar, Wardha Road, Nagpur)

In personal capacity [B-806, Oberoi Exquisite, Oberoi Garden City, Goregaon (East), Mumbai]

In personal capacity (EA-92, Maya Enclave, Hari Nagar, New Delhi)

In personal capacity (E-1, 402, White House Apartments, R.T. Nagar, Bengaluru)

In personal capacity (M1 F1 VGN Minerva Apartments, Guruswamy Road, Nolambur, Chennai) Representative(s)

SHRI ARVIND SHRIVASTAVA
SHRI N. M. RAO (Alternate)

Dr Suguna Naik

Shri Vijaykumar R. Kulkarni Shri Anil Kulkarni (*Alternate*)

JOINT DIRECTOR (B&S)/CB-I
JOINT DIRECTOR (B&S)/CB-II (Alternate)

SHRI GIRISH BONDE

Shri D. N. Vishwanath (Alternate)

SHRI MAHESH TANDON

SHRI VINAY GUPTA (Alternate)

Shri S. N. Diwakar

Shri Manos Kumar De (Alternate)

Dr V. Ramachandra

DR A. K. SINGH (Alternate)

SHRI S. K. KHARE

SHRI B. P. GUPTA (Alternate)

Shri R. K. Jain

Shri L. K. Jain

Shri A. K. Jain

SHRI R. C. WASON

Shri S. A. Reddi

DR C. RAJKUMAR

Panel for Revision of Indian Standards on Test Methods for Concrete, CED 2:2/P7

Organization

In Personal Capacity (EA-92, Maya Enclave, Hari Nagar, New Delhi 110064)

ACC Limited, Mumbai AIMIL Ltd. New Delhi

Central Public Works Department, New Delhi

Central Soil and Materials Research Station, New Delhi

Civil-Aid Technoclinic Pvt Ltd, Bengaluru

CSIR - Central Building Research Institute, Roorkee

CSIR - Central Road Research Institute, New Delhi CSIR - Structural Engineering Research Centre, Chennai

Hindustan Construction Company Ltd, Mumbai

Hydraulic & Engineering Instrument, New Delhi

Indian Concrete Institute, New Delhi

Indian Institute of Technology Madras, Chennai

Indian Institute of Technology Delhi, New Delhi

Representative(s)

SHRI R. C. WASON (Convener)

REPRESENTATIVE

Dr V. M. Sharma

Shri Ajay Prakash Mathur Shri Rajesh Khare (*Alternate*)

Shri U. S. Vidyarthi

Dr R. Nagendra

SHRI SUNIL V. SONNAD (Alternate)

Dr A. K. PANDEY

SHRI S. K. SINGH (Alternate)

REPRESENTATIVE

Dr P. Srinivasan

Dr S. Bhaskar (Alternate)

Dr Chetan Hazaree

SHRI AVINASH HARDE (Alternate)

REPRESENTATIVE

Shri Ashok Kumar Tiwari

Dr Radhakrishna Pillai

Dr Ravindra Gettu (Alternate)

Dr Shashank Bishnoi Dr S. Gupta (*Alternate*) Organization

Larsen & Toubro Ltd, ECC Division, Chennai

National Council for Cement and Building Materials, Ballabgarh

Nuclear Power Corporation of India Ltd, Mumbai

RDC Concrete (India) Pvt Ltd, Mumbai

Ready Mixed Concrete Manufacturers' Association, Mumbai

In personal capacity (50 Mangla Apartments Kalkaji, New Delhi)
In personal capacity (Type IV/17, President's Estate, New Delhi)

Representative(s)

Shri B. Sivarama Sarma Shri S. Manohar (*Alternate*)

Shri V. V. Arora Shri S. C. Sharma (*Alternate*)

Shri Arvind Shrivastava Shri A. K. Laharia (*Alternate*)

Shri K. Tagore Shri V. Meikanda Moorthy (*Alternate*)

Shri Vijaykumar R. Kulkarni Shri Jean Philippe Thierry (*Alternate*)

DR S. C. MAITI SHRI K. H. BABU

Bureau of Indian Standards

BIS is a statutory institution established under the *Bureau of Indian Standards Act*, 2016 to promote harmonious development of the activities of standardization, marking and quality certification of goods and attending to connected matters in the country.

Copyright

BIS has the copyright of all its publications. No part of these publications may be reproduced in any form without the prior permission in writing of BIS. This does not preclude the free use, in the course of implementing the standard, of necessary details, such as symbols and sizes, type or grade designations. Enquiries relating to copyright be addressed to the Director (Publications), BIS.

Review of Indian Standards

Amendments are issued to standards as the need arises on the basis of comments. Standards are also reviewed periodically; a standard along with amendments is reaffirmed when such review indicates that no changes are needed; if the review indicates that changes are needed, it is taken up for revision. Users of Indian Standards should ascertain that they are in possession of the latest amendments or edition by referring to the latest issue of 'BIS Catalogue' and 'Standards: Monthly Additions'.

This Indian Standard has been developed from Doc No.: CED 02 (10897).

Amendments Issued Since Publication

Amend No.	Date of Issue	Text Affected

BUREAU OF INDIAN STANDARDS

Headquarters:

Manak Bhavan, 9 Bahadur Shah Zafar Marg, New Delhi 110002

Telephones: 2323 0131, 2323 3375, 2323 9402 Website: www.bis.org.in

Regional	Offices:	Telephones
Central	: Manak Bhavan, 9 Bahadur Shah Zafar Marg NEW DELHI 110002	$\begin{cases} 2323 & 7617 \\ 2323 & 3841 \end{cases}$
Eastern	: 1/14 C.I.T. Scheme VII M, V. I. P. Road, Kankurgachi KOLKATA 700054	$\begin{cases} 2337 8499, 2337 8561 \\ 2337 8626, 2337 9120 \end{cases}$
Northern	: Plot No. 4-A, Sector 27-B, Madhya Marg, CHANDIGARH 160019	$\begin{cases} 26\ 50206 \\ 265\ 0290 \end{cases}$
Southern	: C.I.T. Campus, IV Cross Road, CHENNAI 600113	{ 2254 1216, 2254 1442 2254 2519, 2254 2315
Western	: Manakalaya, E9 MIDC, Marol, Andheri (East) MUMBAI 400093	$\begin{cases} 2832\ 9295,\ 2832\ 7858\\ 2832\ 7891,\ 2832\ 7892 \end{cases}$

Branches: AHMEDABAD. BENGALURU. BHOPAL. BHUBANESWAR. COIMBATORE. DEHRADUN. DURGAPUR. FARIDABAD. GHAZIABAD. GUWAHATI. HYDERABAD. JAIPUR. JAMMU. JAMSHEDPUR. KOCHI. LUCKNOW. NAGPUR. PARWANOO. PATNA. PUNE. RAIPUR. RAJKOT. VISAKHAPATNAM.